

FILE NAME: \\K-FS1\LIBRARY\CAD\DETAILS\DISTRICTS\CROSS VALLEY WATER DISTRICT\TBR-1.DWG


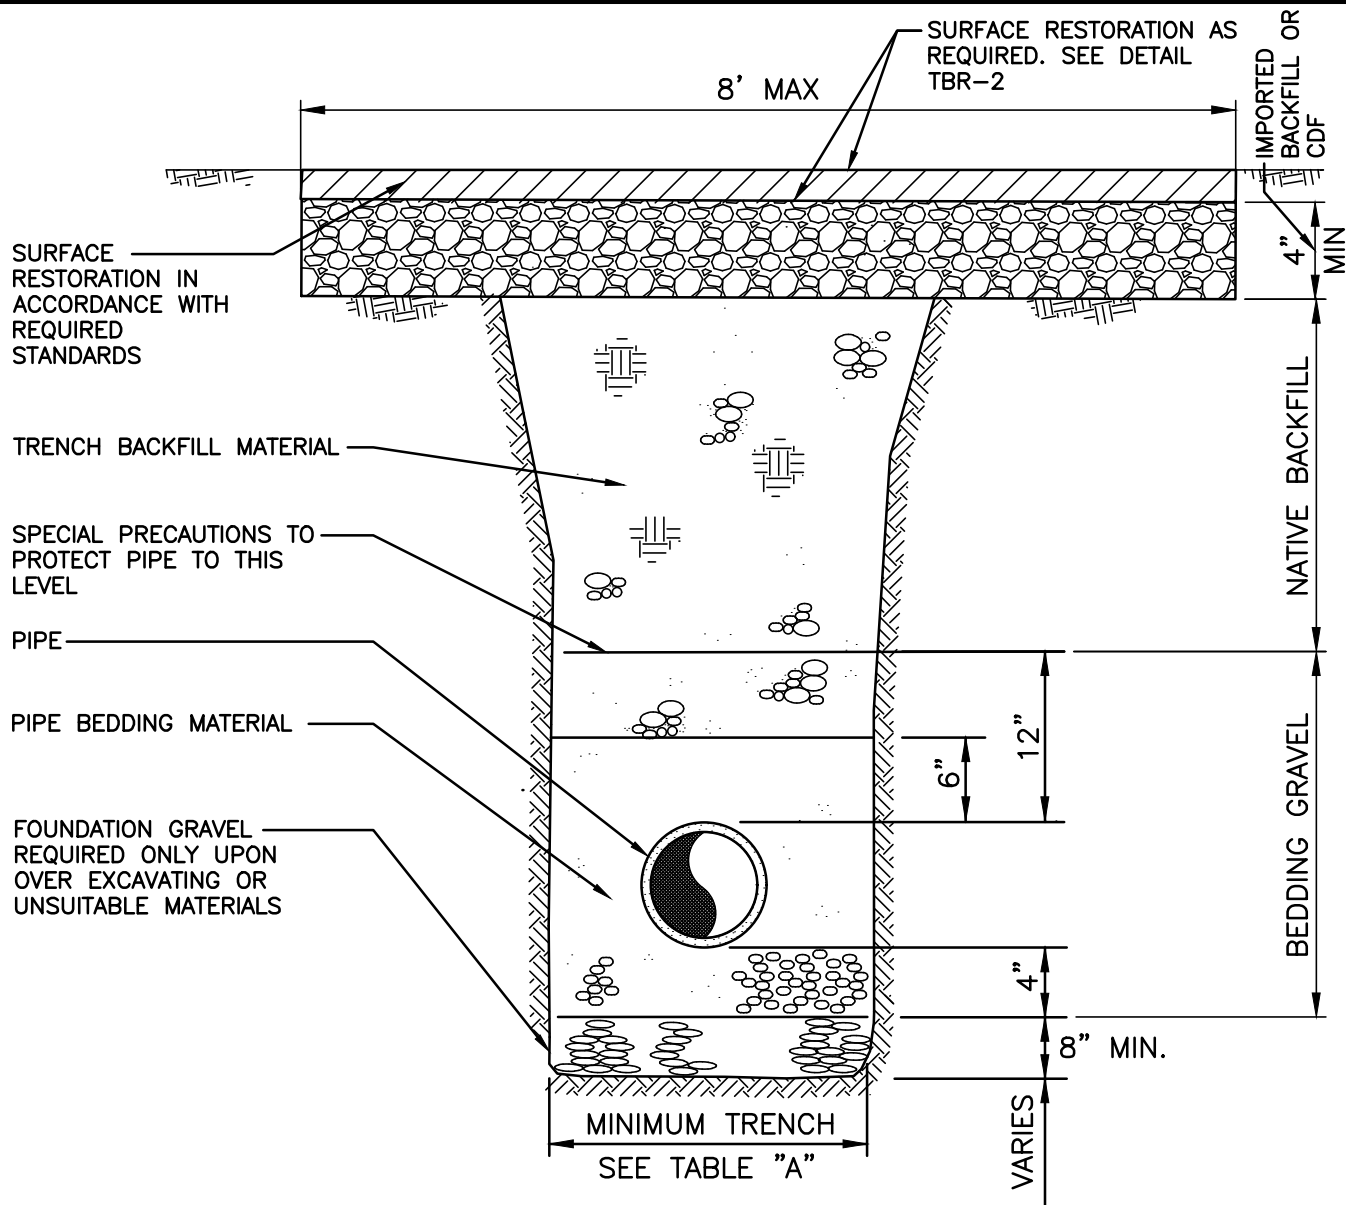


TABLE "A"

6" PIPE	-2'-6"
8" PIPE	-2'-6"
10" PIPE	-3'-0"
12" PIPE	-3'-0"
16" PIPE	-3'-6"
18" PIPE	-4'-0"
24" PIPE	-4'-0"

TRENCH BOTTOM DETAIL

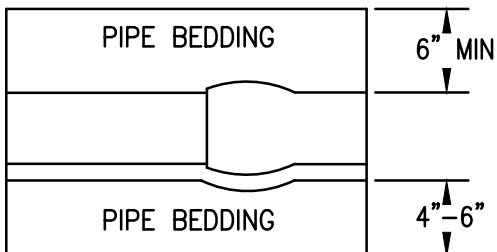

KEEP TRENCH BOTTOM COMPACTED WITH UNIFORM GRADE. NO TEMPORARY SUPPORTS I.E. BLOCKS, ALLOWED TO SUPPORT PIPE. TRENCH BOTTOM SHALL BE TO GRADE PRIOR TO PIPE INSTALLATION.

NOTES:

1. REFERENCE SNOHOMISH COUNTY ENGINEERING DESIGN AND DEVELOPMENT STANDARDS, SECTION 8.
2. SURFACE RESTORATION IN ACCORDANCE WITH SNOHOMISH COUNTY REQUIREMENTS.
3. MAXIMUM TRENCH WIDTH:
15" DIAMETER PIPE AND SMALLER = 40"
16" DIAMETER PIPE AND SMALLER = $1-1/2 \times \text{I.D.} + 18"$

CROSS VALLEY WATER DISTRICT
TRENCH BACKFILL AND RESTORATION

TRENCH SECTION - PIPE
BEDDING AND TRENCH BACKFILL

TBR-1

NOT TO SCALE

FEB 2022