



FILE NAME: \\K-FS1\LIBRARY\CAD\DETAILS\DISTRICTS\CROSS VALLEY WATER DISTRICT\SS-9.DWG

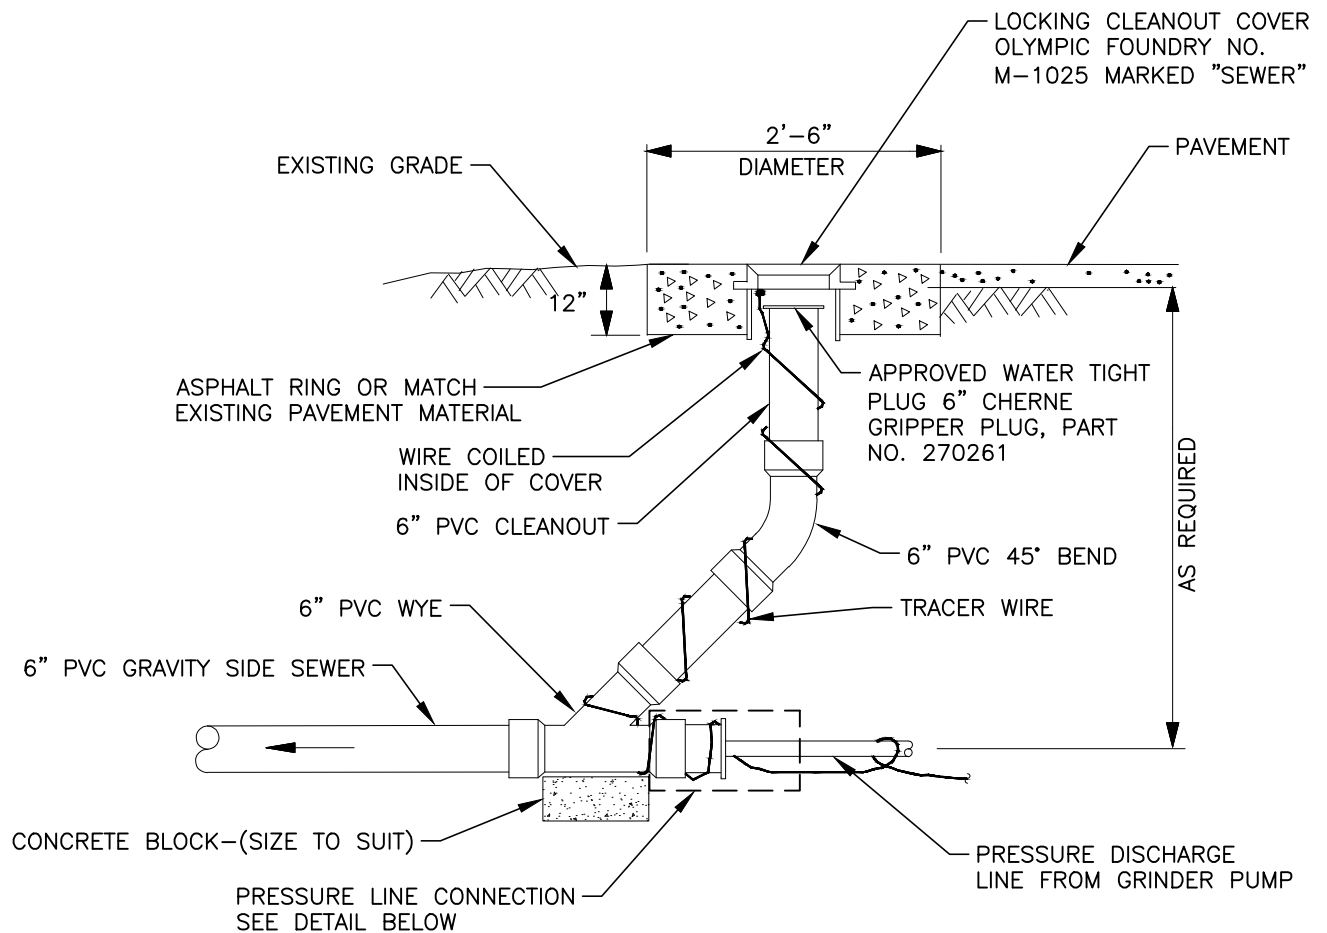

**NOTES:**

1. ALL PVC FITTINGS SHALL BE GASKETED
2. NO COLLECTION VALVE BOX REQUIRED WHEN CONNECTING TO A GRAVITY SIDE SEWER

**CONNECTION TO GRAVITY SEWER DETAIL**

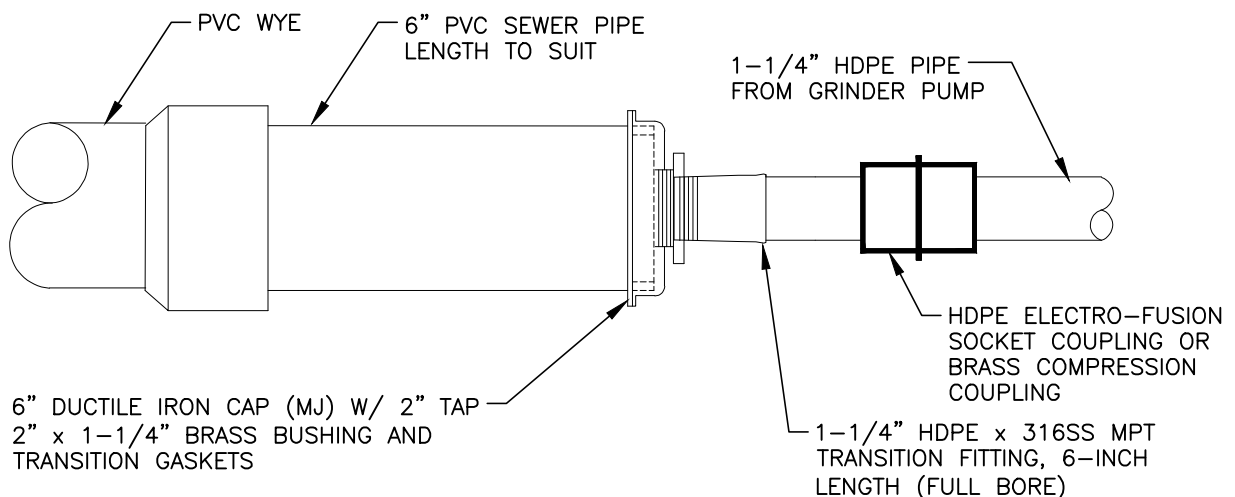

**CROSS VALLEY WATER DISTRICT  
SIDE SEWER DETAILS**

**PRIVATE PRESSURE LINE  
CONNECTION TO GRAVITY SEWER**

SS-9

NOT TO SCALE

FEB 2022