


WHERE PROPOSED UTILITY LINE CROSSES UNDER A.C. PIPE, A SECTION OR SECTIONS OF A.C. PIPE MUST BE REPLACED WITH A SINGLE SECTION OF DUCTILE IRON PIPE, CEMENT LINED, CLASS 52, OR C-900 DR 18, OF SIZE REMOVED.

PIPE TO BE P.E. x P.E. WITH TRANSITION COUPLINGS ON EACH END. DUCTILE IRON OR C-900 PIPE AND COUPLINGS TO BE POLY-WRAPPED.

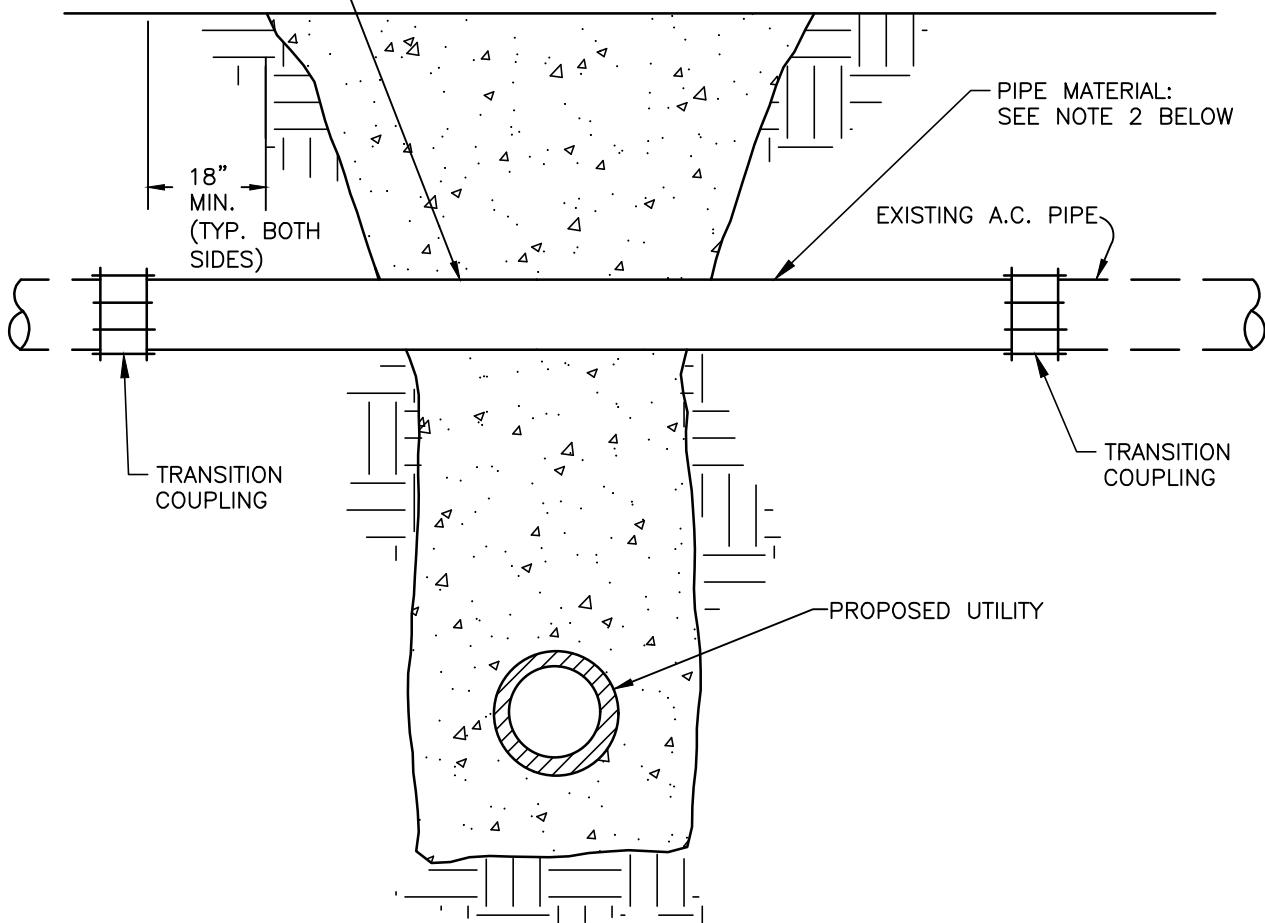

CROSSING A.C. PIPE

NOTES:

1. IF A.C. PIPE IS TO BE SAWCUT OR REMOVED, THE CONTRACTOR SHALL ADHERE TO ALL REGULATIONS OF THE ENVIRONMENTAL PROTECTION AGENCY, PUGET SOUND AIR POLLUTION CONTROL AGENCY, LABOR AND INDUSTRY AND ANY OTHER AGENCY WITH JURISDICTION.
2. PIPE MATERIAL SHALL BE DUCTILE IRON CL. 52 IF COVER IS 2 FEET OR LESS, OR IF VERTICAL SEPARATION FROM PROPOSED UTILITY BEHNEATH IT IS LESS THAN 18 INCHES. IN ALL OTHER SITUATIONS, C-900, DR 18 MAY BE USED.