PARALLEL CONSTRUCTION

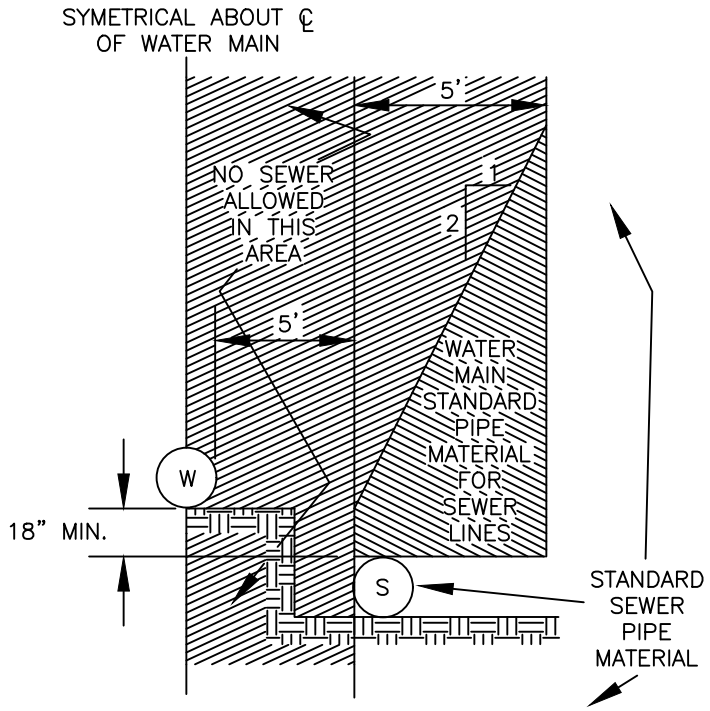

TABLE 1

WATER MAIN STANDARD PIPE MATERIAL

TYPE OF PIPE	AWWA (ASTM) STANDARD		
	PIPE	JOINT	FITTINGS
DUCTILE IRON	C 151 & C104	C 111	C 153
PVC	C900	D3139	C 111

ALL WATER AND SEWER LINE SEPARATION SHALL MEET DOE STANDARDS

NOTES:

FOR PERPENDICULAR CONSTRUCTION, MAINTAIN 18" VERTICAL SEPARATION OR CONSTRUCT SEWER LINE USING WATER MAIN STANDARDS SET FORTH ABOVE WITH MINIMUM 18 FEET LENGTH CENTERED OVER CROSSING TO MAXIMIZE JOINT SEPARATION.

PRESSURE SEWER PIPES SHALL BE CONSTRUCTED PER WATER MAIN STANDARDS.

CROSS VALLEY WATER DISTRICT STANDARD WATER DETAILS	MINIMUM SEPARATION STANDARDS		
	WD-9A	NOT TO SCALE	FEB 2022

FILE NAME: \\K-FS1\LIBRARY\CAD\DETAILS\DISTRICTS\CROSS VALLEY WATER DISTRICT\WD-9A.DWG