


WATER PIPE SCHEDULE

"A" PIPE SIZES	"B" MIN. CASING SIZES	CASING WALL THICKNESS
6"	12"	.25"
8"	16"	.25"
10"	20"	.344"
12"	24"	.406"
14"	28"	.469"
16"	32"	.50"


SEWER PIPE SCHEDULE

"A" PIPE SIZES	"B" MIN. CASING SIZES	CASING WALL THICKNESS
6"	12"	.25"
8"	16"	.25"
10"	18"	.312"
12"	20"	.334"
15"	24"	.406"

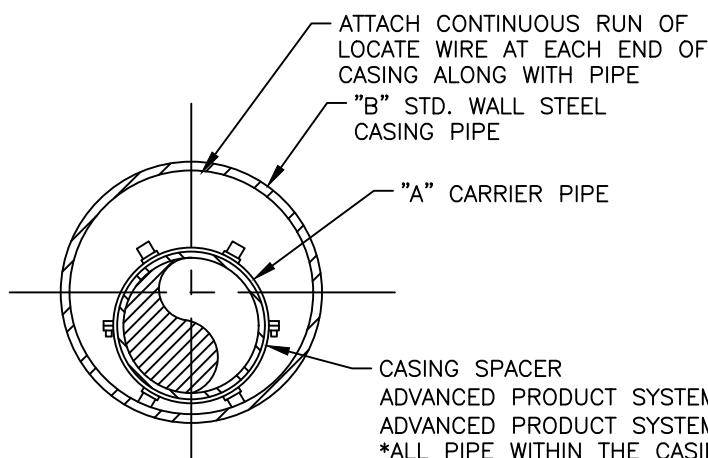

SECTION A-A

ADVANCED PRODUCT SYSTEMS MODEL SSI (D.I. PIPE)
 ADVANCED PRODUCT SYSTEMS MODEL CI (PVC PIPE)
 *ALL PIPE WITHIN THE CASING SHALL BE DI WITH RESTRAINED JOINTS INTEGRAL TO THE PIPE BELL SUCH AS U.S PIPE TR FLEX OR EQUAL. FIELD-LOCK GASKETS AND MJ RESTRAINED GLANDS ARE NOT ACCEPTABLE IN CASINGS.

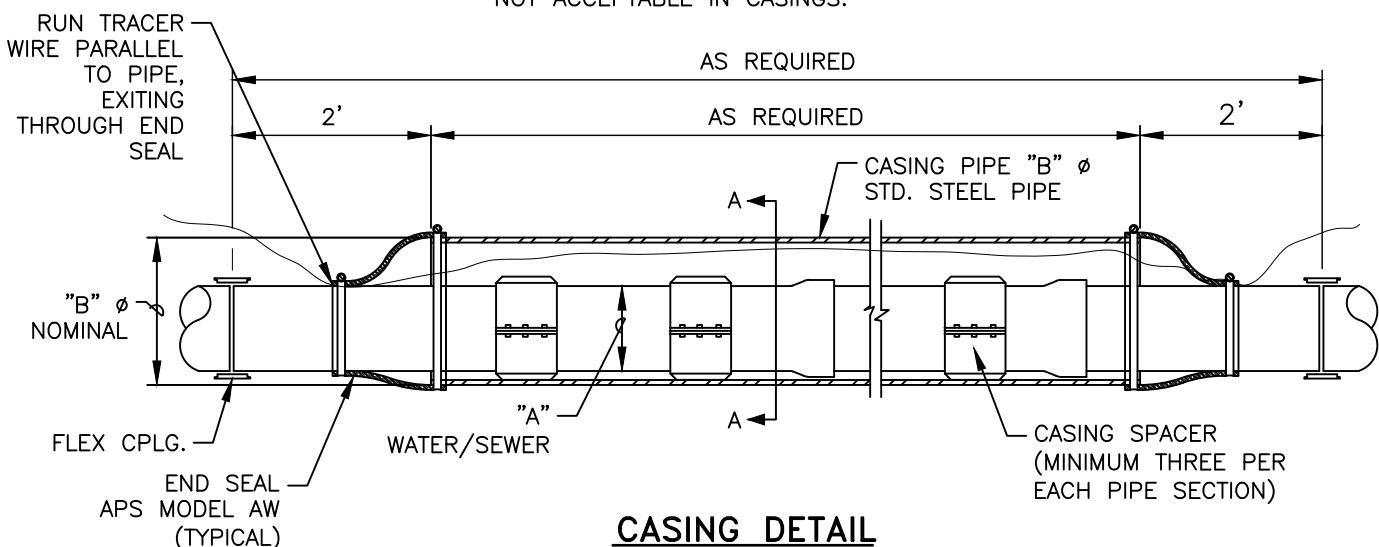

CASING DETAIL