


PROVIDE BLOCK OUT FOR  
METER BOXES IN  
DRIVEWAYS PREAPPROVAL  
REQUIRED  
SEE DETAIL WD-5A

SEE NOTE B

## PUBLIC

PRIVATE

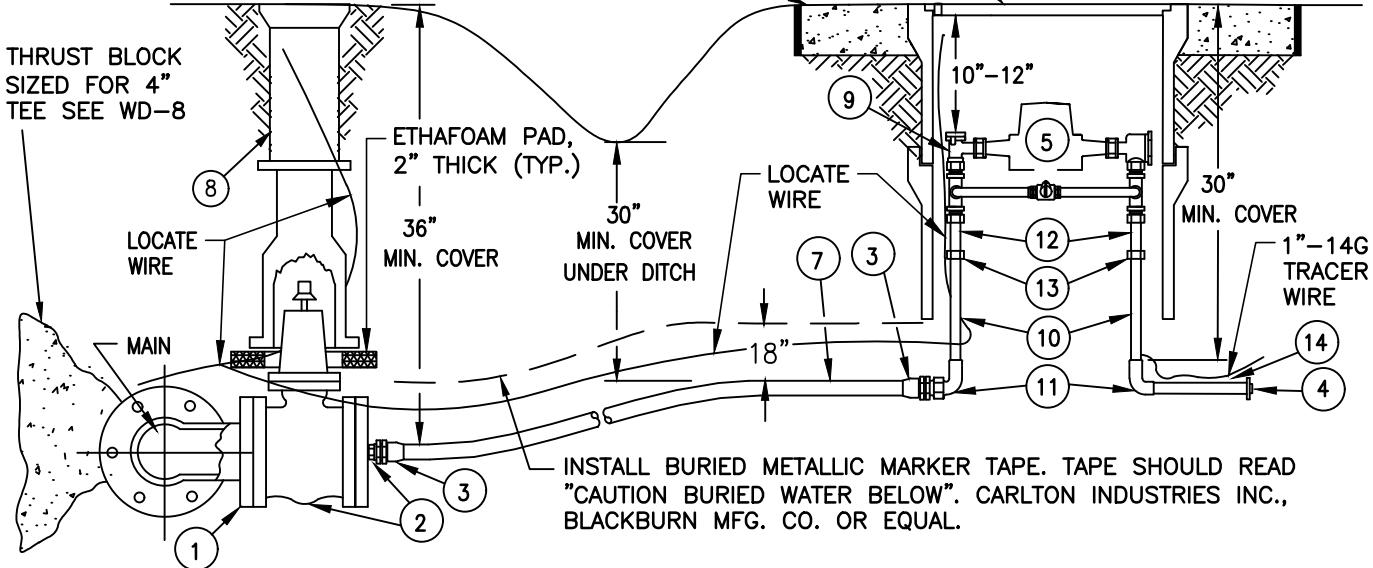

NO.	ITEM
1	DISTRICT-APPROVED TEE X 4" (FL)
2	4" R/W GATE VALVE (FL X FL) 4" X 2" COMPANION FLANGE (FIPT)
3	2" FORD GRIP JOINT
4	2" PLASTIC CAP (SCHEDULE 40)
5	2" BADGER RECORDALL METER SUPPLIED BY DISTRICT AFTER PURCHASE
6	REFER TO DETAIL WD-5 FOR METER BOX TYPE
7	2" TYPE K COPPER PIPE (SOFT) 2" SERVICE PIPE (MAIN TO METER): SDR-7, DRISCO PIPE, IPS, WITH 14-GAUGE LOCATING WIRE (SOLID, NO STRANDS), OR COPPER TUBING, TYPE K, INSTALLED IN POLYETHYLENE WRAP FOR A MINIMUM OF 3' FROM WATER MAIN
8	CAST-IRON VALVE BOX WD-11, 18" TOP, 30" BOTTOM
9	2" BRASS METER SETTER WITH HIGH BYPASS AND LOCKING BALL VALVE FORD VBH77-12HB-11-77-NL WITH VERTICAL IN AND OUT CONNECTION
10	2" BRASS NIPPLE 6" LONG MIN. (MIPT)
11	2" BRASS 90° ELBOW (FIPT)
12	2" NIPPLE 3" LONG MIN.
13	2" BRASS UNION (FIPT)
14	2" BRASS NIPPLE 2' MIN. (EXTEND TO BACK OF SIDEWALK IF NECESSARY)

**NOTES:**

NOTE:

- A. NO SPLICES ALLOWED UNLESS APPROVED BY DISTRICT. USE FORD QUICK JOINT.
- B. OWNERS ARE RESPONSIBLE FOR INSTALLING PRESSURE REDUCER ON THEIR SYSTEM TO PROTECT THEIR FACILITIES FROM HIGH PRESSURE, UNLESS OTHERWISE SHOWN ON DRAWING.
- C. SURFACE RESTORATION IN ACCORDANCE WITH JURISDICTIONAL AUTHORITY.
- D. 4" SAND BEDDING REQUIRED ON ALL COPPER.
- E. ALL FITTINGS SHALL BE "LEAD FREE".