


LIST OF ACCEPTABLE FIRE HYDRANTS:
 EAST JORDAN WATERMASTER 5CD250 WITH 4" STORZ
 AMERICAN DARLING B62B HIGH PRESSURE
 MUELLER SUPER CENTURION 250

FIRE HYDRANT 5 1/4" MAIN VALVE OPENING
 1- 4 1/2" PUMPER CONNECTION (NST) WITH 4" STORZ ADAPTER
 2- 2 1/2" HOSE CONNECTION (NST)
 1- 6" MECHANICAL JOINT INLET WITH LUGS
 1- 1 1/4" PENTAGON OPERATING NUT OPENING COUNTERCLOCKWISE.
 PAINT HYDRANT WITH TWO COATS OF RUST-OLEUM
 HIGH-PERFORMANCE PROTECTIVE ENAMEL 7543
 "SAFETY YELLOW"

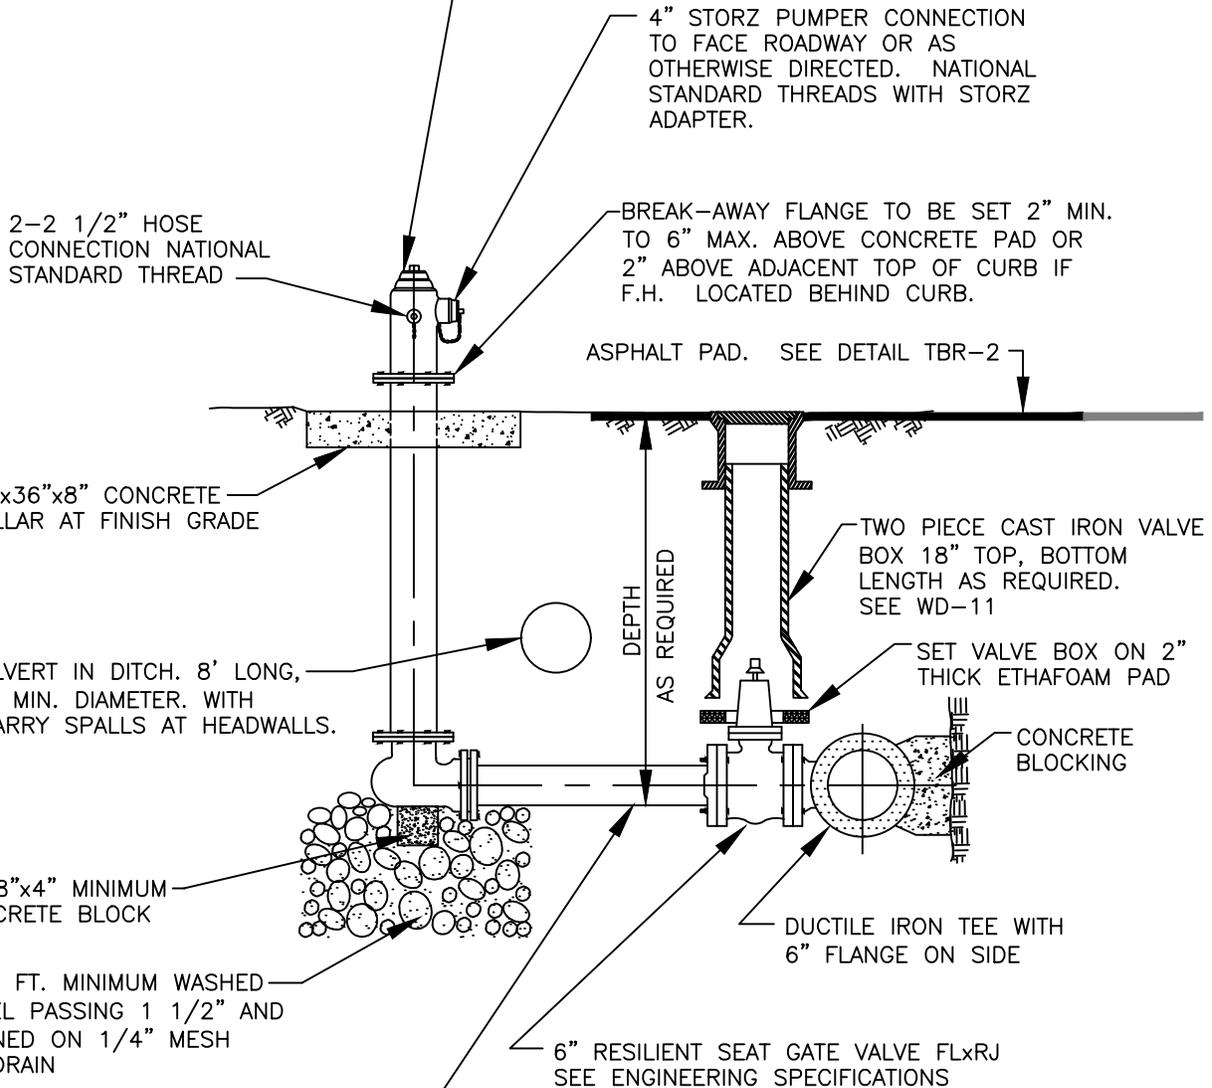

6" DUCTILE IRON CLASS 52 PIPE WITH POLY WRAP AND RESTRAINED JOINTS ENTIRE LENGTH, INCLUDING VALVE AND HYDRANT BEND.

NOTE:
 HYDRANTS NOT IN SERVICE SHALL BE COVERED WITH BLACK HEAVY DUTY LAWN AND GARDEN BAG, SECURE WITH DUCT TAPE OR ELECTRICAL TAPE

**CROSS VALLEY WATER DISTRICT
 STANDARD WATER DETAILS**

FIRE HYDRANT ASSEMBLY

WD-7

NOT TO SCALE

APR 2024

FILE NAME: L:\CAD\DETAILS\DISTRICTS\CROSS VALLEY WATER DISTRICT\WD-7.DWG